



Important Safety Notice

Feb. 12, 2015

Dear Valued Customer:

Walter Kidde Portable Equipment Inc. ("Kidde") in conjunction with the U.S. Consumer Product Safety Commission (CPSC) announced a voluntary recall to replace certain Kidde black plastic Zytel® nylon valve disposable fire extinguishers. A copy of a safety notice is enclosed. It should be prominently posted until the date specified on the notice in the locations that sold the affected models identified below. To view the release, please visit <http://www.cpsc.gov/en/Recalls>.

This replacement program was initiated because certain disposable fire extinguishers may not fully discharge when the lever is repeatedly pressed and released. The cause is an out-of-specification valve component.

This recall involves Kidde ABC and BC-rated fire extinguishers manufactured between July 23, 2013 and Oct. 15, 2014 and sold between August 2013 and November 2014. Models are as follows:

FX340SC	RESSP	FC110
FX340GW	Mariner 5 G	FX10
2A10BC	Mariner 5	FX210R
FA10G	FA5B	5BC
FA110	FX5II	5BCW
Mariner 110	FC5	1A 10BC
Mariner 10	FX210	10BC
FX10BC	KFH Twin	1A 10BCW
FX10K	M110 Twin	FH/RESSP
FC10	M5 Twin	XL 5MR
FX210W	FA5B	

If you receive consumer inquiries, please direct them to contact Kidde at 1-855-283-7991 or www.Kidde.com to determine whether their extinguishers are affected. Kidde will issue a credit for any returned units. The attached cross-reference list contains SKU numbers of potentially impacted units as well as an RMA number with instructions on where to send affected units. Please send a replacement purchase order to Kidde to replenish your inventory. Please note a new part number (N Suffix), UPC and I2 of 5 has been assigned to the units we will ship going forward. Please update your internal records to reflect this change.

If you have questions, please contact your regional sales manager. We apologize for any inconvenience this may cause and thank you for your cooperation in this matter.

Sincerely,

Chris Rovenstine
Vice President, Sales and Marketing
Kidde

SAFETY NOTICE

EXTINGUISHER IDENTIFICATION GUIDE



Issue:

A faulty valve component can cause the disposable fire extinguisher not to fully discharge when the lever is repeatedly pressed and released during a fire emergency, posing a risk of injury.

Description of Products:

Involves 31 models of Kidde ABC or BC rated extinguishers manufactured between July 23, 2013 and October 15, 2014. The fire extinguishers are white, red, or silver in color. They are comprised of several sizes and fire ratings, from a 5BC rated fire extinguisher to a 3A40BC rated extinguisher. The Kidde logo and serial number is on the nameplate for each unit. A 10-digit date code is ink jet printed onto each extinguisher near the bottom of the cylinder. Digits five through nine represent the day and year of manufacture in DDDYY format.

Example: Date code is 0101273145. The digits 27314 signify it was manufactured on the 273rd day of 2014, or September 30, 2014. This unit would be among those affected.

Remedy: Replace Unit.


Please call 855-283-7991 between 8:00 a.m. – 5:00 p.m. EST Monday through Friday, except holidays, or visit our website at www.kidde.com. Please keep extinguisher until you receive a replacement from Kidde.

Post through June 2015

In cooperation with the U.S. Consumer Product Safety Commission

RETURNS INSTRUCTIONS

- 1) Please ensure that the outer carton has the following 4" diamond markings on two opposite sides of each carton

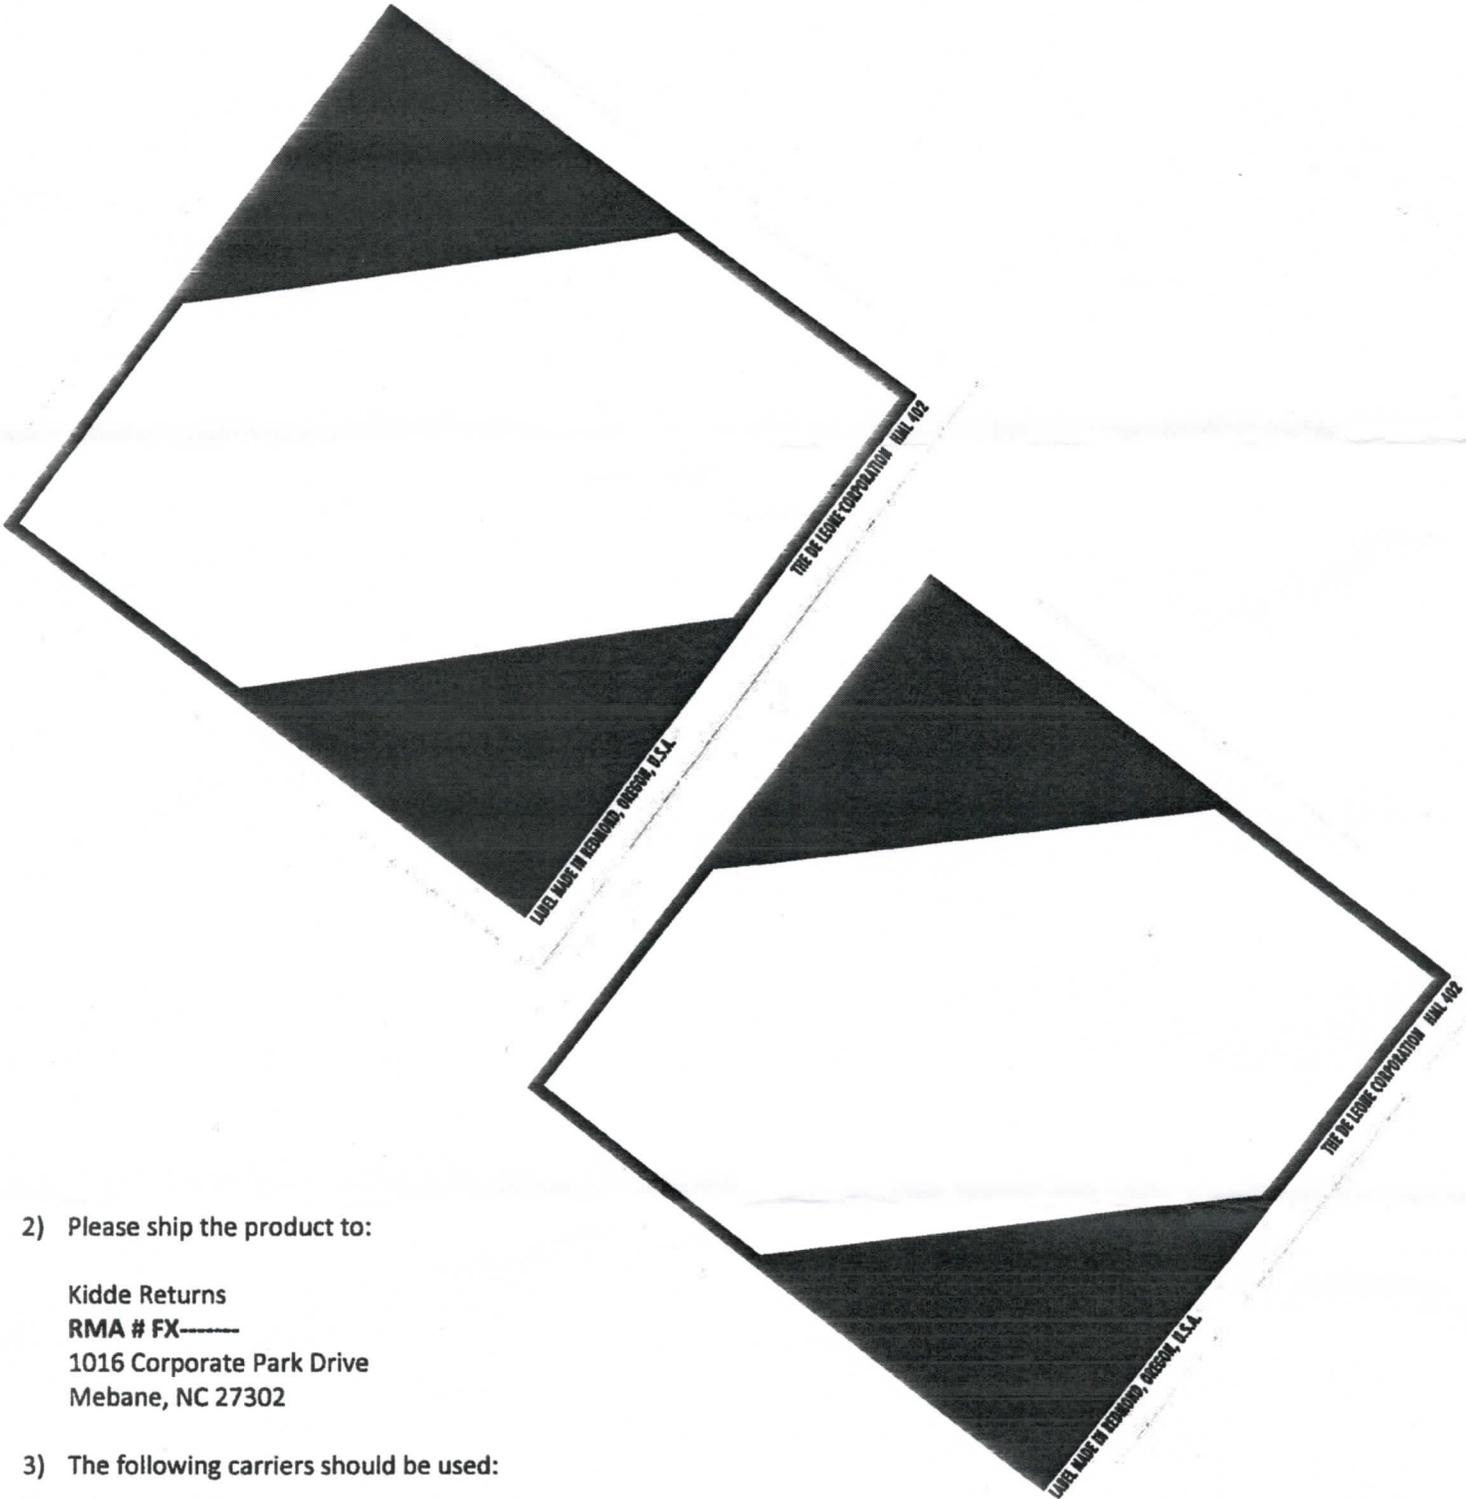

- 2) Please ship the product to:

Kidde Returns
RMA # FX-----
1016 Corporate Park Drive
Mebane, NC 27302

- 3) The following carriers should be used:

Small Package Less than 300 lbs – UPS Ground – 3rd Party Billing – 207217
LTL or Non-Parcel - Over 300 lbs & less than 10,000 lbs (less than ¾ trailer)
OK & TX AL, AR FL GA LA MS NC SC TN VA = Southern Freight Lines 803-794-7300 – Acc # 010-108676

ALL OTHER STATES = Estes Express Lines 804-353-1900 – Acc # 1789804

- 4) For Questions please contact: Vikky Diaz at 1-800-880-6788 ext 8534 or Vikky.Diaz@kiddeus.com